

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23

This is the peer reviewed version of the following article:

Batas-Bjelic, I., Rajakovic, N. & Duic, N. Smart municipal energy grid within electricity market.
Energy **137**, 1277-1285,
<https://doi.org/10.1016/j.energy.2017.06.177>



This work is licensed under a [Creative Commons Attribution Non Commercial No Derivatives 4.0](https://creativecommons.org/licenses/by-nc-nd/4.0/) license

24

25

Smart Municipal Energy Grid within Electricity Market

26

27

28

Ilija Batas-Bjelic*, Nikola Rajakovic

29

Department of Power Systems, School of Electrical Engineering, University of Belgrade,
Serbia

30

31

e-mail: Batas@etf.rs, Rajakovic@etf.rs

32

Neven Duic

33

Faculty of Mechanical Engineering and Naval Architecture

34

University of Zagreb, Zagreb, Croatia

35

e-mail: Neven.Duic@fsb.hr

36

ABSTRACT

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

A smart municipal energy grid including electricity and heat production infrastructure and electricity demand response has been modeled in HOMER case study with the aim of decreasing total yearly community energy costs. The optimal configurations of used technologies (photovoltaic plants, combined heat and power plants, wind power plants) and sizing, with minimal costs, are presented and compared using three scenarios of average electricity market price 3.5 c€/kWh, 5 c€/kWh and 10 c€/kWh. Smart municipal energy grids will have an important role in future electricity markets, due to their flexibility to utilize excess electricity production from CHP and variable renewable energy sources through heat storage. This flexibility enables the levelized costs of energy within smart municipal energy grids to decrease below electricity market prices even in case of fuel price disturbances. With initial costs in the range 0- 3,931,882 €, it has been shown that economical and environmental benefits of smart municipal energy grids are: the internal rate of return in the range 6.87-15.3%, and CO2 emissions in the range from -4,885,203 to 5,165,780 kg/year. The resulting realistic number of hours of operation of combined heat and power plants obtained by simulations is in the range 2,410- 7,849 hours/year.

* Corresponding author

52 **KEYWORDS**

53 Smart grid, demand response, district heating, real time pricing.

54 **HIGHLIGHTS**

- 55 • A smart municipal energy grid has been modeled in HOMER.
- 56 • The national electricity grid has been modeled with real time prices.
- 57 • Smart municipal grids could utilize excess electricity as their heat source.
- 58 • The hours of operation should be obtained with respect to hourly simulations.
- 59 • Smart municipal energy grids reduce energy costs below the assumed market price.

60 **ABBREVIATIONS**

BGCHP	Biogas CHP
BMS	Biomass
CAPEX	Capital Investment Costs
CHP	Combined Heat and Power
HOMER	Hybrid Optimization of Multiple Energy Resources
IRR	Internal Rate of Return
LHV	Lower Heating Value
NGCHP	Natural Gas CHP
O&M	Operation and Maintenance
OPEX	Operation Costs
PV	Photovoltaic

61

62 **1. INTRODUCTION**

63 Future energy systems are in transition towards increased flexibility in operation which will
64 bring economic benefits [1]. One of these benefits might be the decrease in the levelized cost of
65 energy, which is a sound basis for final customer pricing. The demand response as a locally
66 available flexibility property, has been shown in [2]. It helps that these decentralized smart multi-
67 energy systems [3, 4] of future become more efficient, environmentally friendly, and reliable [5].
68 Reliability will be more and more important as the number of natural disasters such as floods
69 will increase in future [6], therefore increasing the need for more resilient smart municipal grids
70 [7, 8].

71 A possible smart isolated grid configuration with demand response and a biogas combined
72 heat and power plant has economic benefits thanks to its flexibility, which is proven using the
73 Hybrid Optimization of Multiple Energy Resources (HOMER) simulation tool [9]. HOMER
74 defines the levelized costs of energy as the average cost per kWh of useful electrical energy
75 produced by the system, excluding the costs for serving the thermal load. An intermittency
76 friendly system with heat/cold demand and storage, including trading electricity on the market,
77 has been demonstrated for different energy carrier prices in study [10]. A recent study which
78 provides a comparison of the least costly energy storage sizes and technologies [11] could be
79 useful for integration of higher amounts of locally produced energy into smart municipal energy

80 grids and achieving higher resilience standards. A smart municipal energy grid design and
81 economic response to governmental constraints has been shown using HOMER in [12].

82 In the article [13], the flexibility of heat and electricity provision from biomass plants is
83 assessed for Germany but not for Serbia, which is why this case study will be carried out in
84 Serbia for the City of Sabac. A technical feasibility study, including the techno-economic
85 analysis of a combined heat and power plant fuelled by biogas, has been carried out for plant
86 "Voganj" in Ruma, Serbia [14]. The problem of excess electricity and heat has been solved with
87 grid connection and food production nearby. Technical details regarding grid connection of a
88 small biogas plant are known from a similar pilot project in the region [15].

89 The economics of energy production depends significantly on yearly utilization. For heat
90 production only it is hard to run units for more than 2,500–3,000 hours per year [16]; therefore,
91 utilization should mean selling more energy to the national grid within a feed-in tariff scheme
92 [14, 17, 18] or participating in electricity markets. On the other hand feed-in tariff scheme might
93 be insufficient for electricity only utilization [19]. Specific investment costs for the combined heat
94 and power (CHP) plant based on a biogas engine depending on the plant size vary in the range
95 800-9,000 €/kW_{el} [20-22]. They can be estimated more precisely for each size using the formula
96 from [23]. Operation and maintenance (O&M) costs depend on gas quality 0.01-0.02 €/hour*kW
97 for a liquid gas engine [24] and can also be calculated using the formula in [23]. Resulting
98 levelized costs of heat production from waste/crops vary 3.4-6.6 c€/kWh, and for natural gas are
99 3.6 c€/kWh [25]. The levelized costs of electricity produced from a biogas CHP plant are 13
100 c€/kWh_{el}, as calculated in [14]. The price of input feedstock including transport varies from 0-
101 175 €/t feedstock [21], for poultry, 2.5 €/t for pig manure, energy maize 38-68 €/t [18], and food
102 waste 40 €/t [26]. Net costs can be calculated by subtracting the feed-in premium from this cost.
103 Therefore, for the community, the feedstock cost may also become negative [26], which could
104 enact a synergetic effect between agriculture and electricity from renewable energy [15]. It is
105 assumed that for the Republic of Serbia the natural gas price is 0.3-0.4 €/Nm³ for a small
106 consumer, while the fee for connection to the gas transport network is 0.1- 0.2 €/Nm³. A study
107 for the CHP plant in Republic of Serbia [16] has found that the internal rate of return (IRR) is
108 6.92, with payback period of almost 11 years (discount rate 8%). In another study [14], also for
109 the Republic of Serbia, it has been calculated that the payback period for electricity only with the
110 feed-in tariff is 9.8-11 years, and that it is 4.6 years for electricity and heat sold, but with 15-20%
111 interest ratio.

112 The lower heating value (LHV) of biogas varies 12.6 - 22 MJ/kg [18, 27]. The gasification
113 ratio varies from 0.2 [t/t] for energetic crops [28] to 0.7 for manure, assuming the average of 0.5
114 [29]. The carbon content of biogas varies from 25%-45% [18, 22, 27]. Based on emission
115 factors for different energy sources [22] and equipment [29], emission-constrained dispatch
116 might be simulated in HOMER with respect to environmental constraints.

117 Currently, district heating in Serbia is predominantly based on fossil fuel only heat boilers:
118 natural gas (61%), lignite/coal (20%), and fuel oil (18%); there are no renewable district heating
119 grids in Serbia. There have been two energy licenses for biomass cogeneration issued in the
120 municipalities of Prijepolje and Cajetina. There is about 100 MW of biomass cogeneration with
121 640 GWh_{el}/a of electricity production envisaged by the National Renewable Energy Action Plan
122 [30]. According to this plan, the envisaged share of biomass cogeneration in district heating and

123 cooling amounts to 33% of heat energy produced from additionally commissioned facilities
124 (2009-2020), which is around 570 GWh_{th}/a. The electricity produced in Vojvodina, upper part of
125 Republic of Serbia in 2016 was 27.25 GWh, with insignificant heat production [19]. According to
126 the Law on the Privileged Producer, the feed-in tariffs (8.22-13.26 c€/KWh) are available for
127 electricity production from biomass but not either for heat energy or cogeneration. In the case of
128 biogas, feed-in tariffs are recently increased to 15 c€/KWh for the bigger plants (higher rates for
129 plants under 5 MW) and up to working 8,600 hours/year [19]. In addition, the law says that
130 municipalities are responsible for support schemes such as feed-in tariffs for renewable district
131 heating and cooling. On the other hand, a positive economic outlook should be expected from
132 rural communities – they should benefit economically from the localization of the heating and
133 cooling supply chain, but also from food industry, which has a considerable demand for heating
134 in the winter and cooling in the summer, all of which could be supplied by a smart municipal
135 energy grid. The community, the City of Sabac, has a district heating utility named "Toplana-
136 Sabac" with 72.3 MW capacity. Its heat production is mainly based on natural gas (93% of
137 capacity) and a small part on fuel oil (7%). The system supplies heat for about 6,700
138 households and 600 commercial users.

139 A case study should include the biomass district heating/cooling demand for a community of
140 around 450 households and 800 kW in other sectors – industry or services. Most economic
141 studies are based on the simplification of an assumed utilization ratio of biogas, natural gas
142 plants, and a feed-in contract to sell electricity at an agreed price [16, 25]. Utilization ratio is a bit
143 lower due to load management in a smart municipal grid [27]. In this article this has been tested
144 in an hourly simulation of distributed generators' economic dispatch under real time prices for
145 the Republic of Serbia, using a biogas plant as a load management unit, in the case of a smaller
146 community in the City of Sabac. The result is the decrease in operation of those generators with
147 similar payback times due to lowered interest rates.

148 **2. SMART MUNICIPAL GRID MODEL: SABAC COMMUNITY**


149 The HOMER simulation tool has been used for modeling and assessing smart municipal
150 energy grid configurations. It has been used a lot for simulations of integration of variable
151 renewable energy sources [31], it is well documented [32, 33], and contains a useful help file. The
152 tool has been used in a number of techno-economic studies for grid connected and islanded
153 operated systems e.g. [9, 12, 34-41].

154 In the study [36] HOMER was compared to the EnergyPLAN and another self-built tool for
155 assessment of demand response, but without consideration of variable renewable energy sources
156 and heat demand. The high profitability of a smart isolated energy grid based on renewable
157 generation, demand response and biogas CHP plant, has been presented in the case of Congo [9].
158 HOMER has been used as a planning tool for municipal smart energy grids in Serbia for the
159 purpose of the Covenant of Mayors optimal local energy plan [12, 42], but with fixed national
160 electricity grid tariff and not with real time electricity market prices. For more precision in physical
161 electricity grid modeling, HOMER may be soft-linked with the PowerWorld tool like in [34] or used
162 with DigSilent [43][44]. HOMER might be used to model smaller smart household energy systems
163 like in [45], where heat demand was not assessed but only electricity demand. HOMER has been
164 used to model a pumped hydro storage power plant [46] and therefore will be useful in the future to

165 assess demand response potential of water pumps for advanced agriculture in Macva, the state
 166 district surrounding the City of Sabac. In a HOMER study [47] the use of a biogas CHP (BGCHP)
 167 plant in combination of a photovoltaic (PV) and wind generator has been shown to be techno-
 168 economically optimal in the case of a small energy system autonomous from the national grid.
 169 Another HOMER study [48] finds an optimal autonomous microgrid design for Oujda city, Morocco.
 170 HOMER with energyPRO or other tools should be further used for thermal process modeling in
 171 distribution grids, especially in the systems with heat storage [11].

172 When it comes to distributed generation, optimal operation algorithm of weekly simulations,
 173 with respect to detailed generator efficiency modeling and peak demand minimization of an
 174 industrial grid can be found in [49]. Using EnergyPLAN and Matlab, it has been shown [18] that pit
 175 storage has an economic advantage over a biomass power plant for peak shaving.

176 The City of Sabac was selected for the case study of a smart municipal energy grid because of
 177 its significance for the research project "CoolHeating". However, any municipality or city in the
 178 Republic of Serbia, or in the region, may be considered for future case studies. It has been
 179 assumed that a small community consisting of 450 households with heat and electricity demand
 180 and industry with a heating/cooling demand of 800 kW shall be supplied during one year.
 181 Configuration of the smart municipal energy system has been shown in Fig. 1.

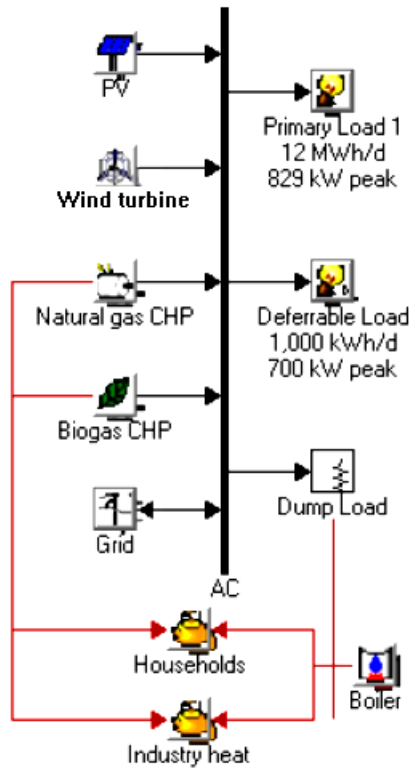

182
 183 **Figure 1 Smart municipal energy grid configuration: PV, Wind turbine, Natural gas CHP generator,**
 184 **Biogas CHP generator, Thermal load: Households, Industry, Primary and deferrable electricity load.**

185 All houses and industry are connected to the national electricity grid and district heating grid
186 which is operated using natural gas boilers. Electricity load is divided into deferrable and non-
187 deferrable (primary) load. Possible investment options are a CHP plant based on biogas or natural
188 gas, photovoltaic (PV), and wind power plants. Also, the option of converting electricity to heat as
189 dump load has been considered [50].

190 **Demand.** It is assumed that in a community with the average household of 100m² and 150
191 kWh_{heat}/ m² * yearly demand, the total household demand is 18,480 kWh_{heat} /day. This is
192 comparable to yearly heat consumption in Austria [50], without hot water, but a sensitivity analysis
193 may be done since other values of yearly consumption are possible. The heat duration curve has
194 been obtained using the degree-day method and average yearly temperature. Additionally, besides
195 heat demand, hot water demand may be also considered in future work [26]. For industrial
196 heat/cold demand, it is assumed that there are 24 working hours 5 days a week during 53 weeks
197 with the constant demand of 800 kW and random day-to-day variability of 10% and hour-to-hour
198 variability of 10%. This is an optimistic assumption since such high utilization rates are not typical
199 for every industry. Besides heating, other or more specific industry heat use options with different
200 demand characteristics may be considered in future, e.g. drying in wood and agriculture industries,
201 or cooling in food industry [27].

202 Electricity demand is assumed to be 10.5 MWh/a per household, resulting in total community
203 demand of 13 MWh/d, of which 12 MWh/day are assumed as primary (nondeferrable) load, and 1
204 MWh/day as deferrable load. The electricity demand assumption is higher than average from
205 around 2.4 M households in the Republic in Serbia and residential consumption of around 13.8
206 TWh/a in the year 2014 [51]. The deferrable load is considered to be max 700 MW, with the ability
207 to "store" max 6,000 kWh.

208 **Generators.** For the PV array lifetime of 15 years, it is assumed that the derating factor is
209 80% and the slope is 32 degrees. The assumed costs are the capital costs of 740€/kW, the
210 replacement of 400€/kW, and operation and maintenance (O&M) of 15€/kW*year, which is low in
211 comparison to example investment costs of 1,231 – 1,403 €/kW, but similar to O&M costs of 12.5 –
212 15.1 €/kW*year [52]. Information on recent investment costs in Denmark and the United Arab
213 Emirates supports this cost assessment, because in these countries costs were even lower.

214 Solar resource inputs per month are given in Table 1 with the average of 3.47 kWh/m²*day. For
215 the wind turbine (S3.7), it is assumed that it has a lifetime of 20 years, hub height of 33.5m,
216 rated power of 1.8 kW, capital and replacement costs of 3,000€, and O&M costs of 30€/year per
217 turbine. The assumed capital costs are in the range of 1,451 – 1,836 €/kW, while the assumed
218 O&M cost are below 35.6 – 47.1 €/kW/year [52].

219

220 Table 1 shows the wind resource yearly average of 3.6 m/s, and the solar resource data
 221 obtained from [53].

222 **Table 1 Solar and wind resource inputs**

Month	Clearness Index	Daily Radiation (kWh/m ² /d)	Wind Speed (m/s)
January	0.410	1.310	5.319
February	0.482	2.240	2.890
March	0.473	3.220	3.209
April	0.466	4.250	2.998
May	0.487	5.280	3.041
June	0.492	5.700	2.141
July	0.515	5.770	3.123
August	0.525	5.120	3.492
September	0.498	3.780	2.539
October	0.463	2.440	3.992
November	0.393	1.380	5.841
December	0.375	1.040	4.590

223


224 For the natural gas CHP (NGCHP) plant, it is assumed that it has a 60,000 working hour
 225 lifetime, the minimal load ratio of 30%, and the heat recovery ratio of 70%. The costs of NGCHP
 226 for different sizes are given in Table 2.

227 **Table 2 Natural gas and biogas CHP costs**

Size (kW)	Natural gas		Biogas	
	Capital / Replacement (€)	O&M (€/hr)	Capital / Replacement (€)	O&M (€/hr)
75	81,337	0.01	661,652	0.035
150	138,654	0.01	1,039,684	0.035
250	205,421	0.01	1,450,597	0.035
500	350,177	0.01	2,279,388	0.025
1,000	596,939	0.01	3,581,705	0.025
2,000	1,017,589	0.006	5,628,095	0.025
3,000	1,390,191	0.006	7,331,163	0.013
5,000	2,059,621	0.006	10,228,649	0.013

228

229 Assumed efficiency curves of the natural gas and biogas plant for different levels of load are
 230 shown in Fig 2.

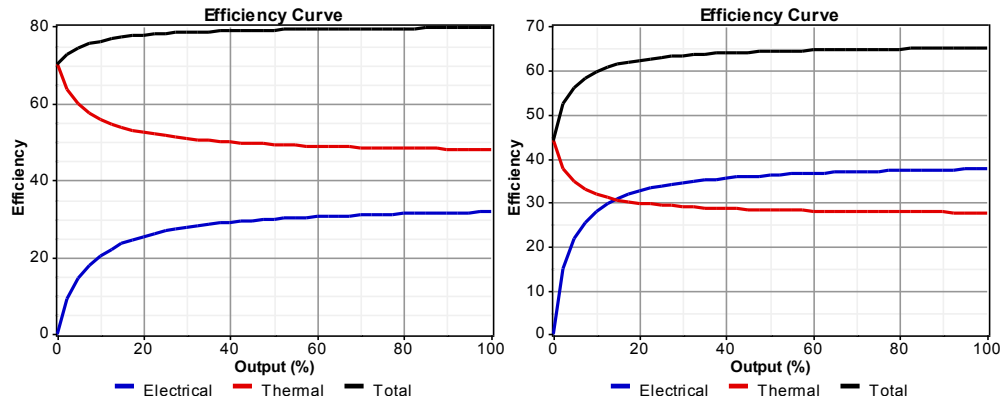

231
232 **Figure 2 Natural gas (left) and biogas (right) CHP efficiency curve**

233

234 The assumed maximal overall efficiency of NGCHP plant at nominal output operation is
235 around 80%.

236 It is assumed that the biogas CHP (BGCHP) plant has a lifetime of 60,000 working hours,
237 minimal load ratio of 30%, and heat recovery ratio of 44%. Typical costs for different sizes of
238 biogas CHP plants (including engine and all facilities costs) are also given in Table 2. Those
239 costs for the BGCHP are within or above the values 1,935 – 6,723.5 €/kW, presented in [52].

240 Capital and replacement costs are the same for the purpose of simplicity. O&M specific
241 costs reduce with plant size.

242 The assumed efficiency curve for the BGCHP plant is lower assuming parasite heat (30%)
243 and power consumption (8%) of the digester [25], as shown in Fig. 2. The data from the biogas
244 plants in operation from [54] are used to calibrate feedstock consumption for biogas production
245 and realistic electricity and heat production. The heat demand of the digester can be modeled in
246 more detail as a separate heat demand with a seasonal effect [27]. Process related details for
247 biogas plants sized 75-500 kW_{el} may be found in [21].

248 The maximal overall energy efficiency of the BGCHP plant is around 65% at nominal output.
249 Besides the modeled CHP plant based on the engine, a gas turbine [55] may also be
250 considered in future techno-economic studies.

251 Optimization search space among different generators and different sizes is shown in Table
252 3.

253


254 **Table 3 HOMER optimization search space (PV Array - photovoltaic array, S3.7 - wind turbine, NGCHP -**
 255 **natural gas CHP, BGCHP - biogas CHP, Grid - national electricity grid connection**

	PV Array	S3.7	NGCHP	BGCHP	Grid
	(kW)	(Quantity)	(kW)	(kW)	(kW)
1	-	-	-	-	1,000
2	250	10	75	75	
3	500	25	150	150	
4			250	250	
5			500	500	
6			1,000	1,000	
7			1,500	1,500	

256

257 The total number of possible system designs is $3 \times 3 \times 7 \times 7 = 441$. Although it is possible to use
 258 continuous variables in optimization, the discrete decision variables are an inherent feature of
 259 the HOMER tool. In order to improve accuracy, one may decide to use more decision variables
 260 around an optimal point or repeat the procedure, but this should be traded with computation
 261 time.

262 **Energy carriers and their prices.** It is assumed that the national electricity grid real-
 263 time price is on average 3 c€/kWh, 5 c€/kWh and 10 c€/kWh. Bearing in mind that wholesale
 264 electricity prices in SEEPEX (Belgrade power exchange) auctions start with the daily average of
 265 2.5 c€/kWh in March 2016 and up to 10 c€/kWh in January 2017, the price assumptions above
 266 are realistic, although it has to be mentioned these are still low volume auctions in comparison
 267 to overall load. The hourly price is dependable on wholesale electricity market prices. The
 268 power density function for the average price of 5 c€/kWh is shown in Fig. 3. For other prices, the
 269 power density function has been translated along the price axis (horizontal x-axis) assuming the
 270 same distribution.

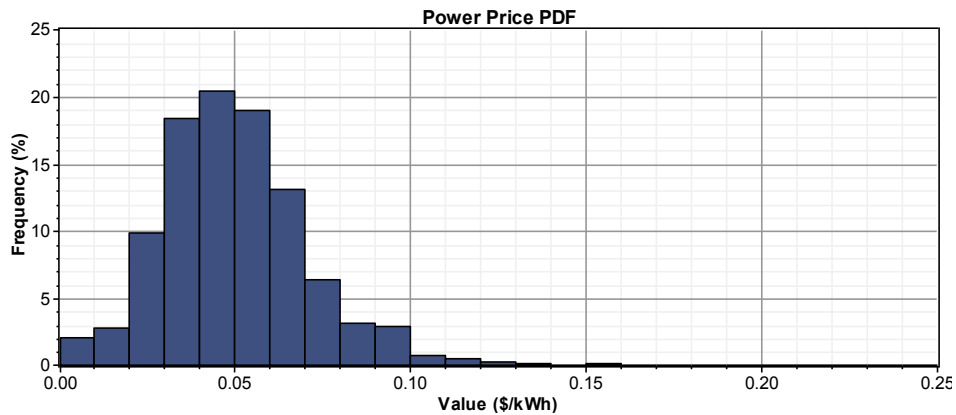

271

272 **Figure 3 Power density function of the national electricity grid hourly price.**

273 For natural gas it is assumed that the lower heating value is 45 MJ/kg [56], density 0.79
 274 kg/m³, carbon content 67%, and sulphur content 0.33%. Regarding biogas, it is assumed that

275 there is a daily average of 1,000 t of manure and organic waste input. The assumed gasification
 276 ratio is 0.5 kg of gas/kg feedstock, the assumed lower heating value of biogas is 18.5 MJ/kg,
 277 and its carbon content is 38%. The assumed lower heating value of biogas and carbon content
 278 are within the range of 21.5-23.5 MJ/kg and 15-45% [27]. Detailed methane production from
 279 different feedstock types may be considered in the future [27]. Maximal manure feedstock costs
 280 for a different feed-in support should not exceed 3-7€/t [17]. Farm distance from the BGCHP
 281 plant and different ownership models (third party or farmers' ownership) result in different
 282 economics of the smart municipal grid, which might be modeled as the increase in the price of
 283 feedstock [57], even in more detail by using geographic information system tools [58].

284 The sensitivity analysis search space of the prices of natural gas and subvention feedstock
 285 are given in Table 4.

286 **Table 4 Sensitivity inputs space**

Biomass (€/t)	Natural gas (€/Nm ³)
-10	0.1
-5	0.2
0	0.3
5	0.4
10	0.5

287

288 The search space for sensitivity analysis consists of 5*5 =25 options, which together with
 289 441 possible system design options, creates 11,025 yearly simulations to run during
 290 optimization.

291 The grid purchase/sale capacity of 1,000 kW is assumed.

292 When it comes to the economic situation, it is assumed that the annual real interest rate is
 293 5%, and the project lifetime is 30 years.

294 The overall biogas production potential in the Republic of Serbia, and for Vojvodina have
 295 been estimated [59, 60] but so far no exact details for the City of Sabac have been available.
 296 Based on the first assessment, the availability of feedstock from animal manure for the City of
 297 Sabac and the district of Macva is given in Table 5. This assessment has to be done with more
 298 detail including other different feedstock and their biogas yield detail [21], as well as other
 299 available sources of dry biomass [61].

300 **Table 5 Available feedstock for biogas production from manure in the Macva state district and City of**
 301 **Sabac.**

Area/Type	Cattle	Pigs	Sheep	Poultry	Σ Feedstock [t/d]
Macva state district	80,283	400,391	161,878	1,060,996	3,591
City of Sabac	26,837	116,881	36,233	289,520	1,117

302


303 When it comes to biomass resource input, the assumed constant annual availability of
 304 feedstock is 1,000 t/d for the first case, but in the future some more realistic assessment needs
 305 to be made, due to availability and possibility of seasonal scheduling.

306 3. RESULTS

307 The optimal system structure graph as a result of HOMER simulations of sensitivity
 308 variables (natural gas price and biomass price) is shown in Fig. 4-6 for differently assumed
 309 national grid electricity price, according to the wholesale market price. The additionally levelized
 310 cost of energy for municipal grid customers (€/kWh) has been superimposed.

311 For the average national grid electricity price of 5c€/kWh, there are three (3) viable optimal
 312 system structures (Fig. 4):

- 313 1. the combination of the national electricity grid with a natural gas generator
 314 (Grid/NGCHP);
- 315 2. the combination of the national electricity grid with a biogas generator (Grid/BGCHP);
- 316 3. the combination of the national electricity grid with a natural gas generator and a biogas
 317 generator (Grid/NGCHP/BGCHP).

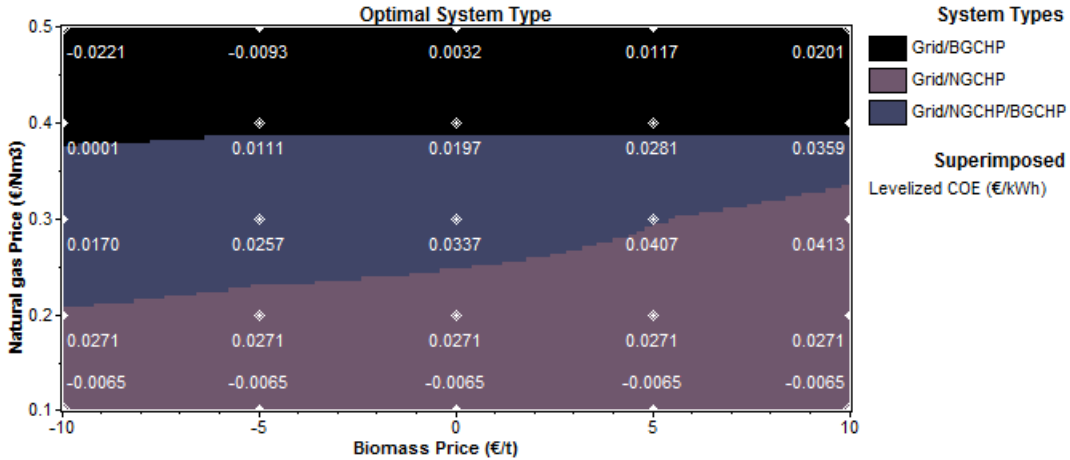

318 4.
 319 5. Figure 4 Optimal system structure for national electricity grid average price of 5c€/kWh.


320 A natural CHP in combination with the national electricity grid is the optimal system structure
 321 for the natural gas price of 0.2 €/Nm3, and up to 0.4 €/Nm3, depending on the price of biomass
 322 (lower area of the graph). The negative levelized cost of energy in the case of extremely low
 323 natural gas prices of 0.1 €/Nm3, shows it is profitable to sell electricity from the NGCHP to the
 324 national grid. In the case the low natural gas price of 0.2 €/Nm3, the levelized cost of energy
 325 may decrease below the average national grid price. The upper triangle of the space defined
 326 with moderate natural gas prices 0.2-0.4 €/Nm3 shows it is optimal to build a BGCHP besides a

327 NGCHP, while for the prices above 0.4 €/Nm³ NGCHP is not profitable. The levelized costs of
 328 energy in all cases are below the national grid average price.

329 The calculated marginal cost of heat from the BGCHP is 0.5 c€/kWh, and from the NGCHP
 330 it is 9 c€/kWh in the [0.3 €/Nm³, 5 €/t] scenario. These marginal costs are calculated based on
 331 the capacity factors obtained through simulation: 72% for the BGCHP and 25% for the NGCHP.

332 For the average national grid electricity price of 3c€/kWh (Fig. 5), there are three viable (3)
 333 optimal system structures:

- 334 1. the national electricity grid (Grid);
- 335 2. a combination of the national electricity grid with a natural gas generator (Grid/NGCHP);
- 336 3. a combination of the national electricity grid with a biogas generator (Grid/BGCHP).

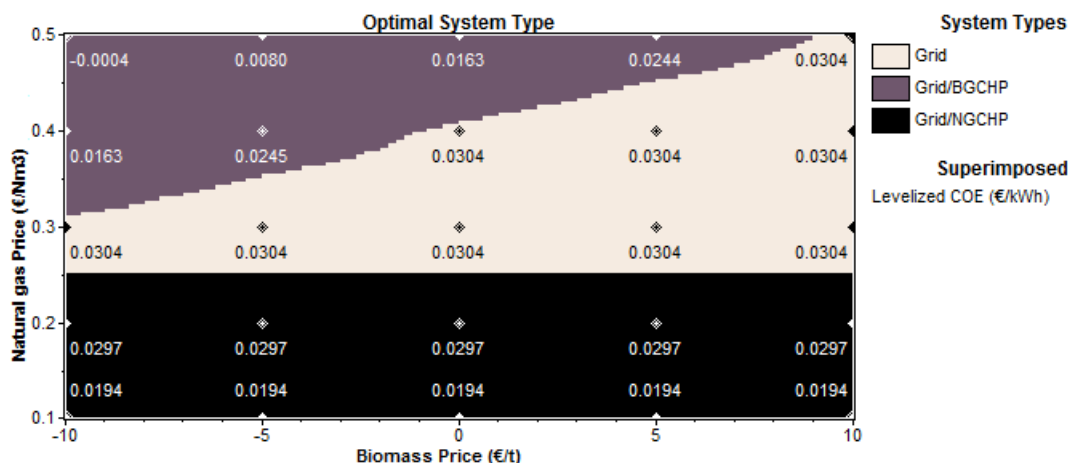


337
 338 **4. Figure 5 Optimal system structure for national electricity grid average price of 3c€/kWh.**

339 The decreased national electricity grid average price of 0.3 c€/kWh resulted in the fact that the
 340 national grid became one of the optimal system types. If the natural gas price is 0.25-0.5 €/Nm³,
 341 the optimal system type depends on the biomass price (the middle triangle of the graph). The
 342 construction of the BGCHP is advised for the natural gas price above 0.3 €/Nm³, in the case of the
 343 subsidized biogas price or above the natural gas price of 0.4 €/Nm³ and 0.5 €/Nm³ for higher
 344 biomass prices (the upper triangle). Below the natural gas price of 0.25 €/Nm³, the combination of
 345 the national grid and the NGCHP is optimal (the lower rectangle). The levelized costs of energy
 346 could be decreased based on the construction of the NGCHP or the BGCHP.

347 For the average national grid electricity price of 10c€/kWh, Fig. 6, there are eight (8) viable
 348 optimal system structures:

- 349 1. a combination of the national electricity grid with a natural gas generator (Grid/NGCHP);

- 350 2. a combination of the national electricity grid with a natural gas and a biogas generator
 351 (Grid/NGCHP/BGCHP);
- 352 3. a combination of the national electricity grid with a PV and natural generator
 353 (Grid/PV/NGCHP);
- 354 4. a combination of the national electricity grid with a PV,natural, and biogas generator
 355 (Grid/PV/NGCHP/BGCHP);
- 356 5. a combination of the national electricity grid with a wind and natural gas generator
 357 (Grid/Wind/NGCHP);
- 358 6. a combination of the national electricity grid with a wind, natural gas and biogas generator
 359 (Grid/Wind/NGCHP/BGCHP);
- 360 7. a combination of the national electricity grid with a PV, wind and natural gas generator
 361 (Grid/PV/Wind/NGCHP);
- 362 8. a combination of the national electricity grid with a PV, wind, natural and biogas generator
 363 (Grid/PV/Wind/NGCHP/BGCHP).

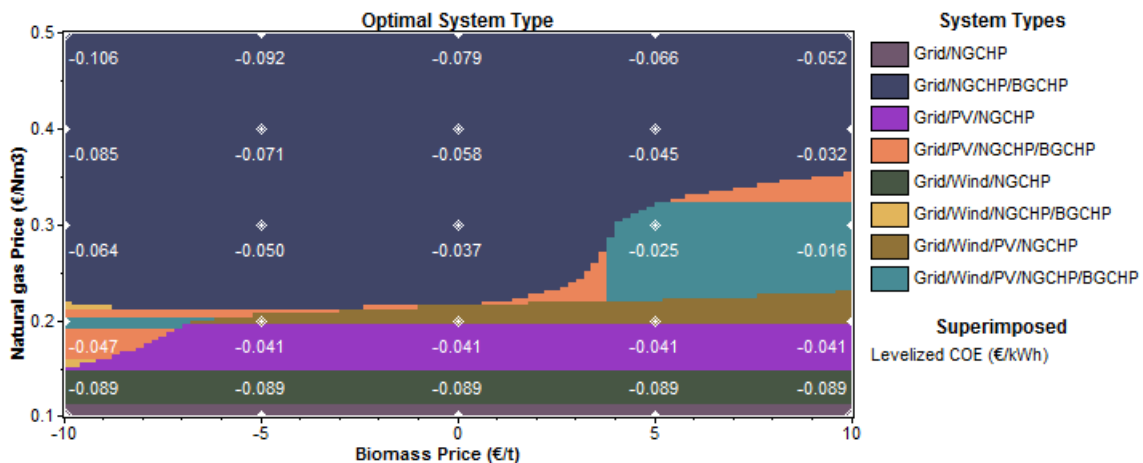

364
 365 **Figure 6 Optimal system structure for national electricity grid average price of 10c€/kWh.**

366 Starting from the natural gas price of 0.1 €/Nm3 for all biomass prices, the combination of
 367 the national electricity grid with a natural gas generator (Grid/NGCHP) is the optimal system
 368 structure, followed by the combination of the national electricity grid with a wind and natural gas
 369 generator (Grid/Wind/NGCHP) first, and later, when the natural gas price reaches 0.2 €/m3, the
 370 combination of the national electricity grid with a PV and biogas generator (Grid/PV/BGCHP).
 371 The natural gas price of 0.35 €/Nm3 is still competitive in three system combinations: the
 372 combination of the national electricity grid with a PV, wind and natural gas generator
 373 (Grid/PV/Wind/NGCHP) shown at the right lower triangle, the combination of the national
 374 electricity grid with a natural gas and biogas generator (Grid/NGCHP/BGCHP), and the
 375 combination of the national electricity grid with a PV, natural and biogas generator

376 (Grid/PV/NGCHP/BGCHP). Above the price of 0.35 €/Nm³, natural gas generators and biogas
 377 generators compete, differently sized for different price combinations.

378 All design cases are profitable for the national electricity grid with the average price of
 379 10c€/kWh and higher because levelized costs of energy are negative.

380 **3.1. Rate of return**

381 The economics of different system configurations for the national electricity grid average
 382 price of 5c€/kWh are shown in Table 6.

383 **Table 6 Economics comparison of different system configurations with base configuration for the**
 384 **5c€/kWh average price and four combinations of biomass and natural gas prices.**

System characteristics	Base	S1	S2	S3	S4	S5
Biomass [€/t]	-	-10	-5	0	5	10
Natural gas [€/Nm ³]	-	0.3				
NGCHP [kW]	-	500	500	500	500	1,000
BGCHP [kW]	-	1,000	1,000	1,000	1,000	-
Grid [kW]	1,000	1,000	1,000	1,000	1,000	1,000
Initial cost [€]	-	3,931,882	3,931,882	3,931,882	3,931,882	596,939
Total cost [€]	11,592,836	9,133,686	9,763,992	10,350,609	10,861,921	10,902,640
Present worth [€]	-	2,459,154	1,828,847	1,242,229	730,917	690,197
Annual worth [€/year]	-	159,971	118,969	80,809	47,547	44,898
Return on investment [%]	-	10.40%	9.41%	8.45%	7.56%	13.9%
Internal rate of return [%]	-	11.10%	9.58%	8.15%	6.87%	15.3%
Simple payback [years]	-	5.16	5.62	6.19	7.04	5.63
Discounted payback [years]	-	6.13	6.77	7.6	8.9	6.78
Hours NGCHP	-	2,410	2,410	2,410	2,410	4,327
Hours BGCHP	-	7,849	7,484	7,031	6,331	-

385

386 The first two rows show the assumed biomass and natural gas prices. The next three rows
 387 show the resulting optimal system structures for the assumed prices. The base system, used for all
 388 comparisons, consists only of the connection to the national electricity grid (Grid). Other scenarios
 389 (S1-5) are:

- 390 • a combination of the national electricity grid with a natural gas generator (Grid/NGCHP);

- a combination of the national electricity grid with a natural gas and biogas generator (Grid/NGCHP/BGCHP).

The selected sizes of biogas generators are 1,000 kW and 500 kW for natural gas generators. The sixth row presents initial costs, which are capital investment costs (CAPEX) for equipment. Assuming that the grid exists, the investment cost for the grid is zero. The total cost, the sum of CAPEX and operation costs (OPEX) over project lifetime, are shown to be lower in scenarios S1-5 than in the base scenario. This results in the return of investment 7.56-10.4% for the Grid/NGCHP/BGCHP system structure, and 13.9% for the Grid/NGCHP system structure. The discounted payback is 6.13-8.9 years, showing that it is sensitive to economic subsidies for biomass. Further calculations may show a desired level of subsidy for biomass.

3.2. Hours of operation

The realistic hours of operation for NGCHP and BGCHP plants, obtained from 8,760 hourly simulations over one year, are shown in the last two rows of the Table 8. The capacity factor is 0.7-0.9 for the profitable BGCHP plant, and 0.25-0.5 for the profitable NGCHP plant. They are not constant but rather dependable on many system design factors. At breakpoints, the hours of operation of one generator structure may suddenly drop to zero, resulting in a jump of the hours of operation of other generator types. Further analysis may show that the BGCHP plant is more profitable than the NGCHP plant only in the higher hours of operation. Those realistic operation conditions should be used for the development of detailed business plans for the future expansion of small municipal distributed grids within the electricity market.

3.3. Environmental benefits

Fig. 7 shows that smart municipal energy grids entail significant environmental benefits, which should not be neglected in the elaboration of their techno-economic optimality.

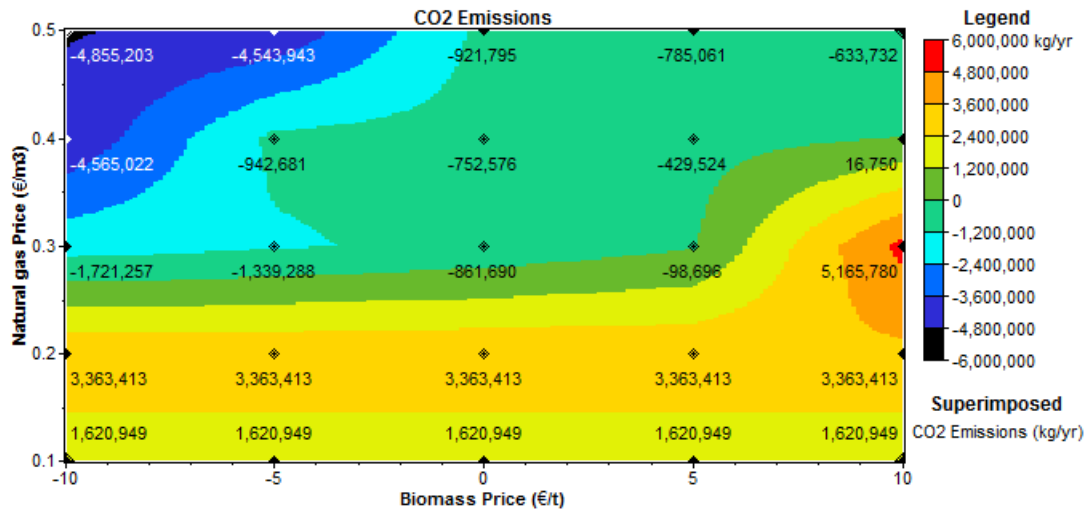


Figure 7 Surface plot of the smart municipal grid yearly CO₂ emissions for the 5c€/kWh average electricity market price and 25 different fuel price scenarios.

417 The yearly CO₂ emissions from the smart municipal grid obtained from the base scenario of
418 7,586,505 kg/year, decrease with investments in all 25 scenarios. This is due to equivalent
419 emission from the electricity grid in the Republic of Serbia, which is significant. The highest
420 emission savings are shown in the scenario with high natural gas costs and strong policy
421 support for biomass, resulting in negative total equivalent emissions of -4,855,203 kg/year,
422 including the exported renewable energy.

423 **4. CONCLUSION**

424 Many municipal grids of today operate connected to the national electricity grid without
425 investment in distributed generation. This article has shown that investment in a smart municipal
426 grid infrastructure could decrease the levelized cost of energy in the municipal grid below the
427 national electricity grid average market price, due to smart municipal grids' flexible operation
428 and optimal sales and purchases. Furthermore, the sensitivity analysis has shown that this
429 would not change even in case of disturbances of natural gas prices or biomass prices.

430 Although the levelized cost of energy in the municipal grid could decrease with optimal
431 investments decisions, the payback periods of the smart municipal infrastructure may
432 additionally decrease with a properly designed local economic support energy policy for the
433 biomass resource.

434 Moreover, the environmental benefits of smart municipal grids are substantial, due to high
435 equivalent emission from the national electricity grid.

436 More detailed results from this paper show that the hours of operation of the CHP plant
437 depend on various system design factors. Therefore, during the planning process it is advised
438 not to assume any constant values for hours of operation (obtained exogenously), but rather
439 obtain them as the result of the optimal investment decision and realistic operation. The hours of
440 operation should not be kept at a constant level in techno-economic feasibility studies when
441 making the investment decision.

442 **5. ACKNOWLEDGEMENTS**

443 The authors are acknowledging the support from the "CoolHeating" Horizon 2020 project
444 from European Commission grant nr. 691679. The first two authors are thankful to the Ministry
445 of Education, Science and Technological development on the grant nr. 42009/11 for the "Smart
446 grids".

447 **6. REFERENCES**

- 448 [1] Mitchell C. Momentum is increasing towards a flexible electricity system based on
449 renewables. *Nature Energy*. 2016;1:15030.
450 [2] Batas Bjelić I, Rajaković N, Čosić B, Duić N. Increasing wind power penetration into the
451 existing Serbian energy system. *Energy*. 2013;57:30-7.

452 [3] Blaauwbroek N, Nguyen PH, Konsman MJ, Huaizhou S, Kamphuis RIG, Kling WL.
453 Decentralized Resource Allocation and Load Scheduling for Multicommodity Smart Energy
454 Systems. *Sustainable Energy, IEEE Transactions on*. 2015;6(4):1506-14.

455 [4] Capuder T, Mancarella P. Techno-economic and environmental modelling and optimization
456 of flexible distributed multi-generation options. *Energy*. 2014;71(0):516-33.

457 [5] Shariatzadeh F, Mandal P, Srivastava AK. Demand response for sustainable energy
458 systems: A review, application and implementation strategy. *Renewable and Sustainable
459 Energy Reviews*. 2015;45:343-50.

460 [6] Roudier P, Andersson JCM, Donnelly C, Feyen L, Greuell W, Ludwig F. Projections of future
461 floods and hydrological droughts in Europe under a +2°C global warming. *Climatic Change*.
462 2015:1-15.

463 [7] Chen C, Wang J, Qiu F, Zhao D. Resilient Distribution System by Microgrids Formation After
464 Natural Disasters. *IEEE Transactions on Smart Grid*. 2016;7(2):958-66.

465 [8] Batas-Bjelic I, Rajakovic N. More resilient smart municipal energy grids. *MEDPOWER*.
466 Belgrade2016.

467 [9] Montuori L, Alcázar-Ortega M, Álvarez-Bel C, Domijan A. Integration of renewable energy in
468 microgrids coordinated with demand response resources: Economic evaluation of a biomass
469 gasification plant by Homer Simulator. *Applied Energy*. 2014;132:15-22.

470 [10] Blarke MB. Towards an intermittency-friendly energy system: Comparing electric boilers
471 and heat pumps in distributed cogeneration. *Applied Energy*. 2012;91(1):349-65.

472 [11] Lund H, Østergaard PA, Connolly D, Ridjan I, Mathiesen BV, Hvelplund F, et al. *Energy
473 Storage and Smart Energy Systems*. 2016. 2016;11:12.

474 [12] Batas Bjelic I, Ciric RM. Optimal distributed generation planning at a local level – A review
475 of Serbian renewable energy development. *Renewable and Sustainable Energy Reviews*.
476 2014;39:79-86.

477 [13] Thrän D, Dotzauer M, Lenz V, Liebetrau J, Ortwein A. Flexible bioenergy supply for
478 balancing fluctuating renewables in the heat and power sector—a review of technologies and
479 concepts. *Energ Sustain Soc*. 2015;5(1):1-15.

480 [14] Ciric RM, Kuzmanovic Z. Techno-Economic Analysis of Biogas Powered Cogeneration.
481 *Journal of Automation and Control Engineering Vol*. 2014;2(1).

482 [15] Krkoleva A, Taseska V, Markovska N, Taleski R, Borozan V. Microgrids: The agraria test
483 location. *Thermal Science*. 2010;14(3):747-58.

484 [16] Stojiljković MM, Stojiljković MM, Blagojević BD, Vučković GD, Ignjatović MG. Effects of
485 implementation of co-generation in the district heating system of the Faculty of Mechanical
486 Engineering in Niš. *Thermal Science*. 2010;14(suppl.):41-51.

487 [17] Puksec T, Duic N. Economic viability and geographic distribution of centralized biogas
488 plants: case study Croatia. *Clean Technologies and Environmental Policy*. 2012;14(3):427-33.

489 [18] Dominković D, Ćosić B, Medić ZB, Duić N. A hybrid optimization model of biomass
490 trigeneration system combined with pit thermal energy storage. *Energy Conversion and
491 Management*. 2015.

492 [19] Zubić B, Prebiračević V. Korišćenje biogasa u Vojvodini. *Energetika. Zlatibor 2017*. p. 61-6.

493 [20] Mitschke T. Small Scale Slurry Biogas Plants for medium-sized farms in Serbia as an
494 additional income source. 2015.

495 [21] FNR. *Guide to Biogas: From Production to Use: Fachagentur Nachwachsende Rohstoffe*
496 2012.

497 [22] Cvetković SM, Kaluđerović-Radoičić TS, Kragić RB, Kijevčanin ML. Electricity production
498 from biogas in Serbia-assessment of emissions reduction. *Thermal Science*. 2015(00):189-

499 [23] Vukašinović V, Babić M, Gordić D, Jelić D, Končalović D. Pregled dostupnih modela gasnih
500 turbina i motora sa unutrašnjim sagorevanjem koji se mogu koristiti u kogeneracionim
501 sistemima. *Energija, ekonomija, ekologija*. 2013;15(3-4):265-78.

502 [24] Wellinger A, Murphy J, Baxter D. *The Biogas Handbook: Science, Production and*
503 *Applications*: Woodhead Pub Limited, 2013.

504 [25] Köttner M, Kayser K. Assessment of the framework conditions for biogas production in
505 Serbia. IBBK Fachgruppe Biogas GmbH 2014. p. 29.

506 [26] Gebrezgabher SA, Meuwissen MPM, Prins BAM, Lansink AGJMO. Economic analysis of
507 anaerobic digestion—A case of Green power biogas plant in The Netherlands. *NJAS -*
508 *Wageningen Journal of Life Sciences*. 2010;57(2):109-15.

509 [27] Rutz D, Mergner R, Janssen R. Sustainable Heat Use of Biogas Plants. *A Handbook,*
510 *Biogas Heat, WIP Renewable Energies*, Munich, Germany. 2012.

511 [28] Murphy J, Braun R, Weiland P, Wellinger A. Biogas from energy crop digestion. Conference
512 *Biogas from energy crop digestion*. IEA Bioenergy Task.

513 [29] DEA. *Technology Data for Energy Plants*. Danish Energy Agency; 2010.

514 [30] ***. *Draft National Renewable Energy Action Plan*. Belgrade: Ministry of Energy,
515 *Development and Environmental Protection of Republic of Serbia*; 2012.

516 [31] Connolly D, Lund H, Mathiesen BV, Leahy M. A review of computer tools for analysing the
517 integration of renewable energy into various energy systems. *Applied Energy*. 2010;87(4):1059-
518 82.

519 [32] Lambert T, Gilman P, Lilienthal P. *Micropower System Modeling with Homer*. Integration of
520 *alternative sources of energy*: John Wiley & Sons, Inc.; 2006. p. 379-418.

521 [33] Chowdhury O, Kim H-g, Cho Y, Shin C, Park J. Optimization of a Hybrid Renewable Energy
522 *System with HOMER*. In: Park D-S, Chao H-C, Jeong Y-S, Park JJ, editors. *Advances in*
523 *Computer Science and Ubiquitous Computing*: Springer Singapore; 2015. p. 93-9.

524 [34] Corrand M, Duncan SJ, Mavris DN. Incorporating Electrical Distribution Network Structure
525 *into Energy Portfolio Optimization for an Isolated Grid*. *Procedia Computer Science*.
526 2013;16:757-66.

527 [35] Weis TM, Ilinca A. The utility of energy storage to improve the economics of wind–diesel
528 *power plants in Canada*. *Renewable Energy*. 2008;33(7):1544-57.

529 [36] Neves D, Pina A, Silva CA. Demand response modeling: A comparison between tools.
530 *Applied Energy*. 2015;146(0):288-97.

531 [37] Basir Khan MR, Jidin R, Pasupuleti J, Shaaya SA. Optimal combination of solar, wind,
532 *micro-hydro and diesel systems based on actual seasonal load profiles for a resort island in the*
533 *South China Sea*. *Energy*. 2015;82(0):80-97.

534 [38] Hafez O, Bhattacharya K. Optimal planning and design of a renewable energy based
535 *supply system for microgrids*. *Renewable Energy*. 2012;45:7-15.

536 [39] Rui H, Low SH, Ufuk T, Chandy KM, Clarke CR. Optimal design of hybrid energy system
537 *with PV/wind turbine/storage: A case study*. Conference *Optimal design of hybrid energy system*
538 *with PV/wind turbine/storage: A case study*. p. 511-6.

539 [40] Giannoulis ED, Haralambopoulos DA. Distributed Generation in an isolated grid:
540 *Methodology of case study for Lesvos – Greece*. *Applied Energy*. 2011;88(7):2530-40.

541 [41] Al-Karaghoulis A, Kazmerski LL. Optimization and life-cycle cost of health clinic PV system
542 *for a rural area in southern Iraq using HOMER software*. *Solar Energy*. 2010;84(4):710-4.

543 [42] Ilija BB. *Subotica: energetski plan održive energetike*. 2017. p. 1-17.

544 [43] Markova KK, Bijelic IB, Dobric G, Rajakovic N. Investment Decisions in the Photovoltaic
545 Power Plant in Terms of the Market Bearing in Mind the Physical Limitations of the
546 Transmission Network. INDEL 2016. Banja Luka2016.

547 [44] Nikola R, Ilija BB. Planning of the optimal energy mix for smart cities. 2017. p. 1-6.

548 [45] Batas Bjelić IR, Škokljević IA, Pukšec T, Krajačić G, Duić N. Integrating the flexibility of the
549 average Serbian consumer as a virtual storage option into the planning of energy systems.
550 Thermal Science. 2014;18(3):743-54.

551 [46] Canales FA, Beluco A. Modeling pumped hydro storage with the micropower optimization
552 model (HOMER). Journal of Renewable and Sustainable Energy. 2014;6(4):043131.

553 [47] Ghaem Sigarchian S, Paleta R, Malmquist A, Pina A. Feasibility study of using a biogas
554 engine as backup in a decentralized hybrid (PV/wind/battery) power generation system – Case
555 study Kenya. Energy. 2015;90, Part 2:1830-41.

556 [48] Zahboune H, Zouggar S, Krajacic G, Varbanov PS, Elhafyani M, Ziani E. Optimal hybrid
557 renewable energy design in autonomous system using Modified Electric System Cascade
558 Analysis and Homer software. Energy Conversion and Management. 2016;126:909-22.

559 [49] Zeljković Č, Rajaković N. Cost-saving potential of customer-driven distributed generation.
560 Electric Power Systems Research. 2012;92(0):87-95.

561 [50] Rutz D, Doczekal C, Zweiler R, Hofmeister M, Jensen LL. Small Modular Renewable
562 Heating and Cooling Grids. Munich: WIP Renewable Energies, 2017.

563 [51] IEA–International Energy Agency.

564 [52] IRENA. Cost-competitive renewable power generation: Potential across South East Europe.
565 2017.

566 [53] Kempener R, Assoumou E, Chiodi A, Ciorba U, Gaeta M, Gielen D, et al. A Global
567 renewable energy roadmap: Comparing energy systems models with IRENA’s remap 2030
568 project. Lecture Notes in Energy. International Renewable Energy Agency, IRENA Innovation
569 and Technology Centre, Bonn, Germany2015. p. 43-67.

570 [54] Djatkov D, Effenberger M, Lehner A, Martinov M, Tesic M, Gronauer A. New method for
571 assessing the performance of agricultural biogas plants. Renewable Energy. 2012;40(1):104-12.

572 [55] Kang JY, Kang DW, Kim TS, Hur KB. Comparative economic analysis of gas turbine-based
573 power generation and combined heat and power systems using biogas fuel. Energy.
574 2014;67:309-18.

575 [56] Demirel Y. Energy, green energy and technology. Springer-Verlag London; 2012.

576 [57] Pukšec T, Duić N. Economic viability and geographic distribution of centralized biogas
577 plants: Case study Croatia. Clean Technologies and Environmental Policy. 2012;14:427-33.

578 [58] Konrad C, Strittmatter J, Grunert A, Brule M, Roth M, Herter M, et al. Regional energy
579 concepts-based on alternative biomass cultivation for rural areas and its efficient energy usage.
580 International Journal of Sustainable Development and Planning. 2013;8(1):59-74.

581 [59] Cvetković S, Kaluđerović Radoičić T, Vukadinović B, Kijevčanin M. Potentials and status of
582 biogas as energy source in the Republic of Serbia. Renewable and Sustainable Energy
583 Reviews. 2014;31:407-16.

584 [60] Martinov M, Đatkov Đ, Krstić J, Vujić G, Tešić M, Dragutinović G, et al. STUDY OF
585 POTENTIALS AND POSSIBILITIES FOR BIOGAS PRODUCTION AND UTILIZATION IN
586 AUTONOMOUS PROVINCE OF VOJVODINA. Novi Sad: Faculty of technical sciences
587 Department of environmental engineering; 2011.

588 [61] Eltrop L, Hertlajn M, Jensen T, Hensler M, Kruk K, Ezdemir ED, et al. Priručnik o čvrstim
589 biogorivima. In: Stručna agencija za obnovljive resurse ru, (FNR), Odeljenje za odnose sa
590 javnošću, editor. Beograd2014. p. 205.